


Misurazioni °C

Sp1	22,8
-----	------

Parametri

Emissività	0.86
Temp. rifl.	20 °C

17/12/2020 21.43.03

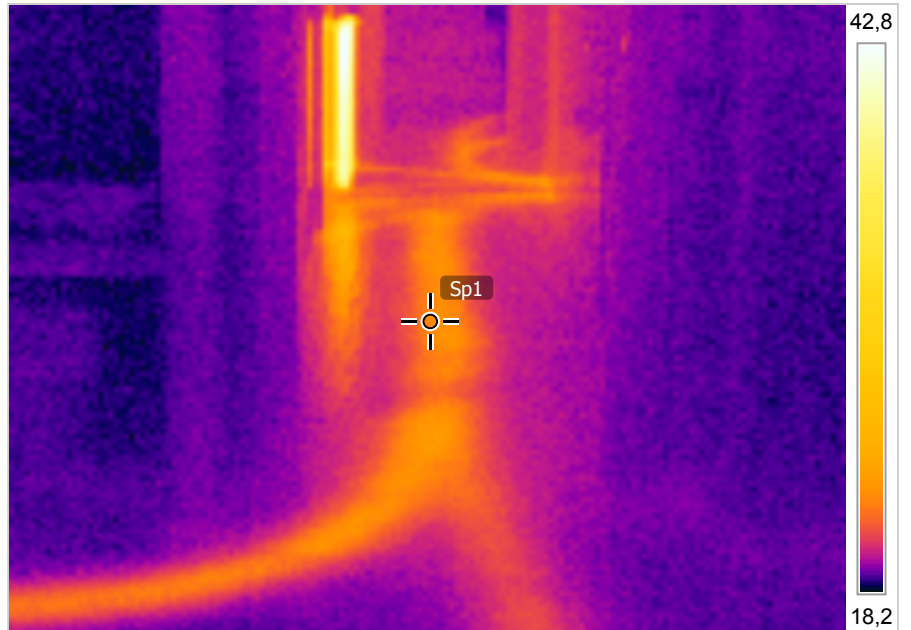

IR\_2083.jpg

FLIR E30bx

49028041

17/12/2020 21.43.03



DC\_2084.jpg


Misurazioni °C

Sp1	22,4
-----	------

Parametri

Emissività	0.86
Temp. rifl.	20 °C

17/12/2020 21.43.31

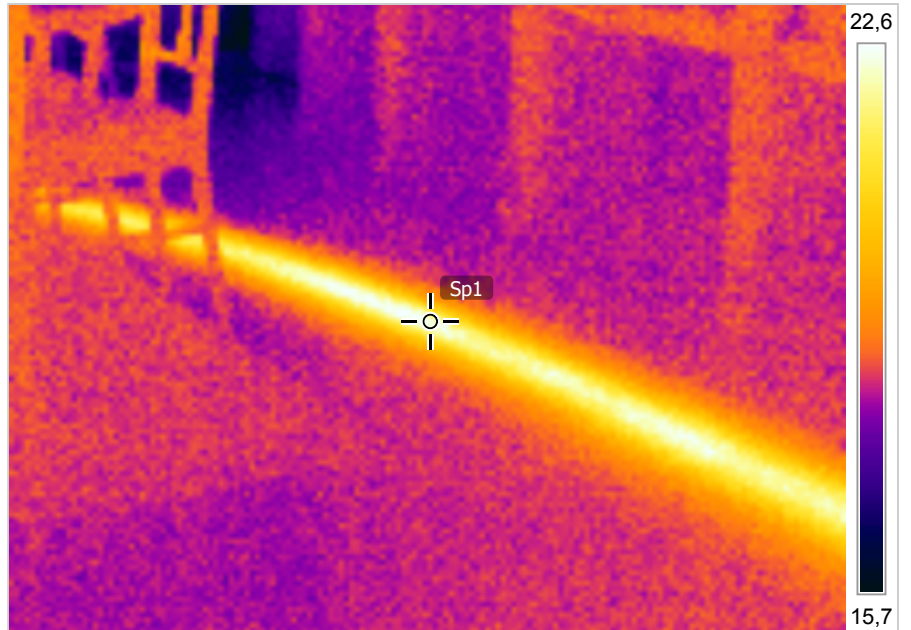


IR\_2087.jpg

FLIR E30bx

49028041

17/12/2020 21.43.31

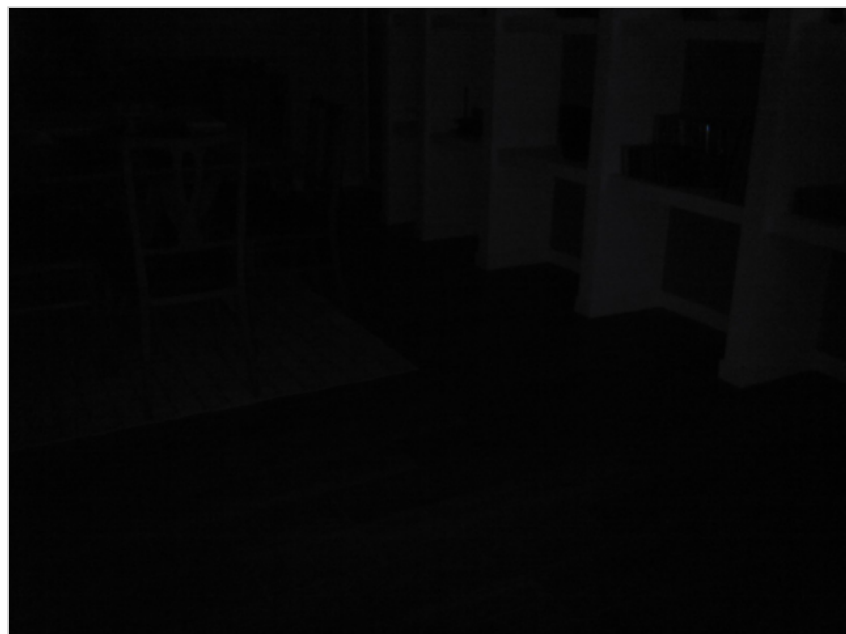

DC\_2088.jpg


Misurazioni °C

Sp1	22,0
-----	------

Parametri

Emissività	0.86
Temp. rifl.	20 °C

17/12/2020 21.45.07

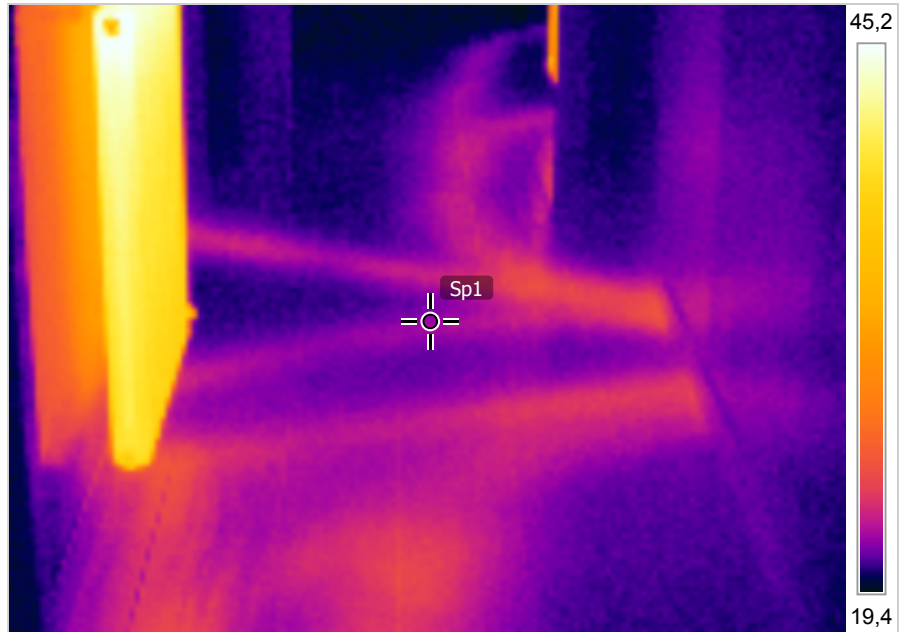


IR\_2095.jpg

FLIR E30bx

49028041

17/12/2020 21.45.07

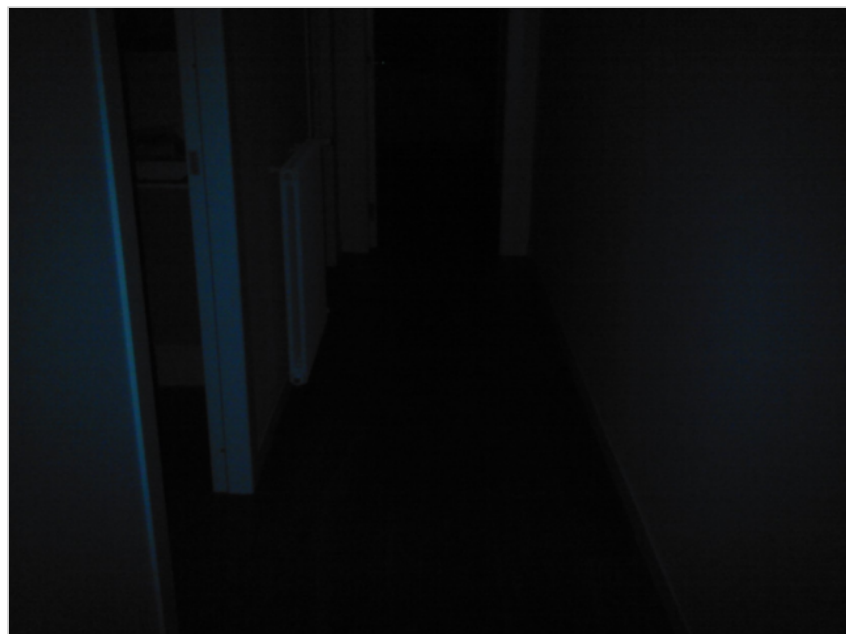

DC\_2096.jpg


Misurazioni °C

Sp1	23,4
-----	------

Parametri

Emissività	0.86
Temp. rifl.	20 °C

17/12/2020 21.49.11

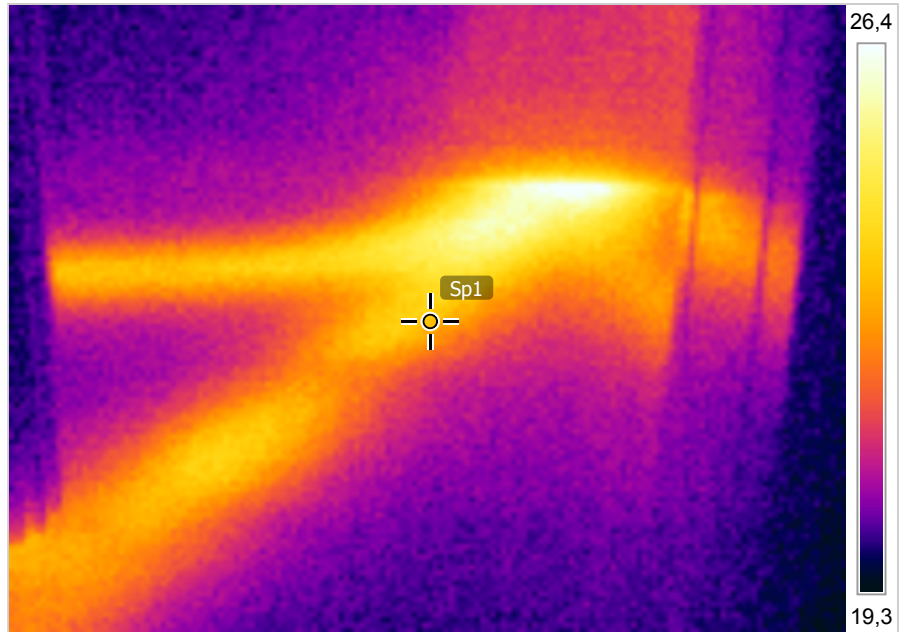

IR\_2113.jpg

FLIR E30bx

49028041

17/12/2020 21.49.11



DC\_2114.jpg